




Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)



Reporting Period: 1 April 2025 - 30 June 2025

Emergency Structure Fires meeting benchmark by Station Maintenance Area

Primarily residential structure fires including commercial centres, industrial and/or community services e.g. schools, facilities, hospitals. FRV has service delivery standards, which specify a response time target for a station to attend an emergency incident. The service delivery standard (response time) for Structure Fire is 7.7 minutes.



% within benchmark

FRV District + Station Maintenance Area	Number of incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents within the Station Maintenance Area for the reporting period	Number of emergency incidents the standards were met by any station	% of emergency incidents the standards were met by any station	The time in minutes in which 90% of emergency incidents were responded to by any station
Central District	252	247	241	97.6%	6.5
01. Eastern Hill	23	23	22	95.7%	6.5
02. West Melbourne	20	19	19	100.0%	6.6
03. Carlton	32	32	32	100.0%	5.8
04. Brunswick	13	13	12	92.3%	6.9
10. Richmond	20	20	20	100.0%	6.7
13. Northcote	11	11	10	90.9%	5.7
18. Hawthorn	18	18	18	100.0%	6.0
35. Windsor	51	49	49	100.0%	6.5
38. South Melbourne	45	44	43	97.7%	5.7
50. Ascot Vale	19	18	16	88.9%	7.6
Eastern District	80	79	74	93.7%	7.1
19. North Balwyn	14	13	12	92.3%	7.6
20. Box Hill	16	16	16	100.0%	6.6
22. Ringwood	10	10	10	100.0%	6.7
23. Burwood	15	15	15	100.0%	7.0
27. Nunawading	10	10	7	70.0%	8.5
28. Vermont South	15	15	14	93.3%	6.8
North West Region	11	11	10	90.9%	6.7
73. Bendigo	11	11	10	90.9%	6.7
Northern District	128	124	112	90.3%	7.7
05. Broadmeadows	28	27	23	85.2%	8.5
06. Pascoe Vale	17	17	17	100.0%	7.2
11. Epping	11	10	10	100.0%	6.2
12. Preston	28	28	28	100.0%	5.4
14. Bundoora	13	11	11	100.0%	6.8
15. Heidelberg	17	17	13	76.5%	7.9
80. Craigieburn	14	14	10	71.4%	10.4
Southern District 1	85	85	78	91.8%	7.5
24. Glen Iris	12	12	12	100.0%	7.4
31. Glen Waverley	14	14	11	78.6%	7.9
32. Ormond	21	21	21	100.0%	7.3
33. Mentone	12	12	11	91.7%	7.2
34. Highett	10	10	8	80.0%	8.1
89. Springvale	16	16	15	93.8%	6.8
Southern District 2	95	92	73	79.3%	8.9
87. Dandenong	21	20	18	90.0%	6.7
88. Hallam	18	17	14	82.4%	7.8
91. Frankston	30	30	26	86.7%	7.9
92. Cranbourne	11	11	6	54.5%	10.0
93. Pakenham	15	14	9	64.3%	11.7
Western District 1	67	64	56	87.5%	7.8
40. Laverton	11	10	7	70.0%	8.4
45. Brooklyn	12	12	12	100.0%	6.2
47. Footscray	31	29	26	89.7%	7.7
57. Tarneit	13	13	11	84.6%	7.7
Western District 2	74	74	60	81.1%	9.4
41. St.Albans	11	11	9	81.8%	9.3
44. Sunshine	16	16	16	100.0%	6.8
51. Keilor (East)	12	12	11	91.7%	7.4
55. Caroline Springs	14	14	8	57.1%	10.8
56. Melton	21	21	16	76.2%	9.0
Western District 3	31	31	23	74.2%	10.0
61. Lara	10	10	3	30.0%	11.5
62. Corio	21	21	20	95.2%	7.5
Total	823	807	727	90.1%	7.7





Response time data for Fire Rescue Victoria (FRV) appliances responding to Structure Fires in the FRV Fire District where the FRV appliances are primary appliances (1st appliance onscene)







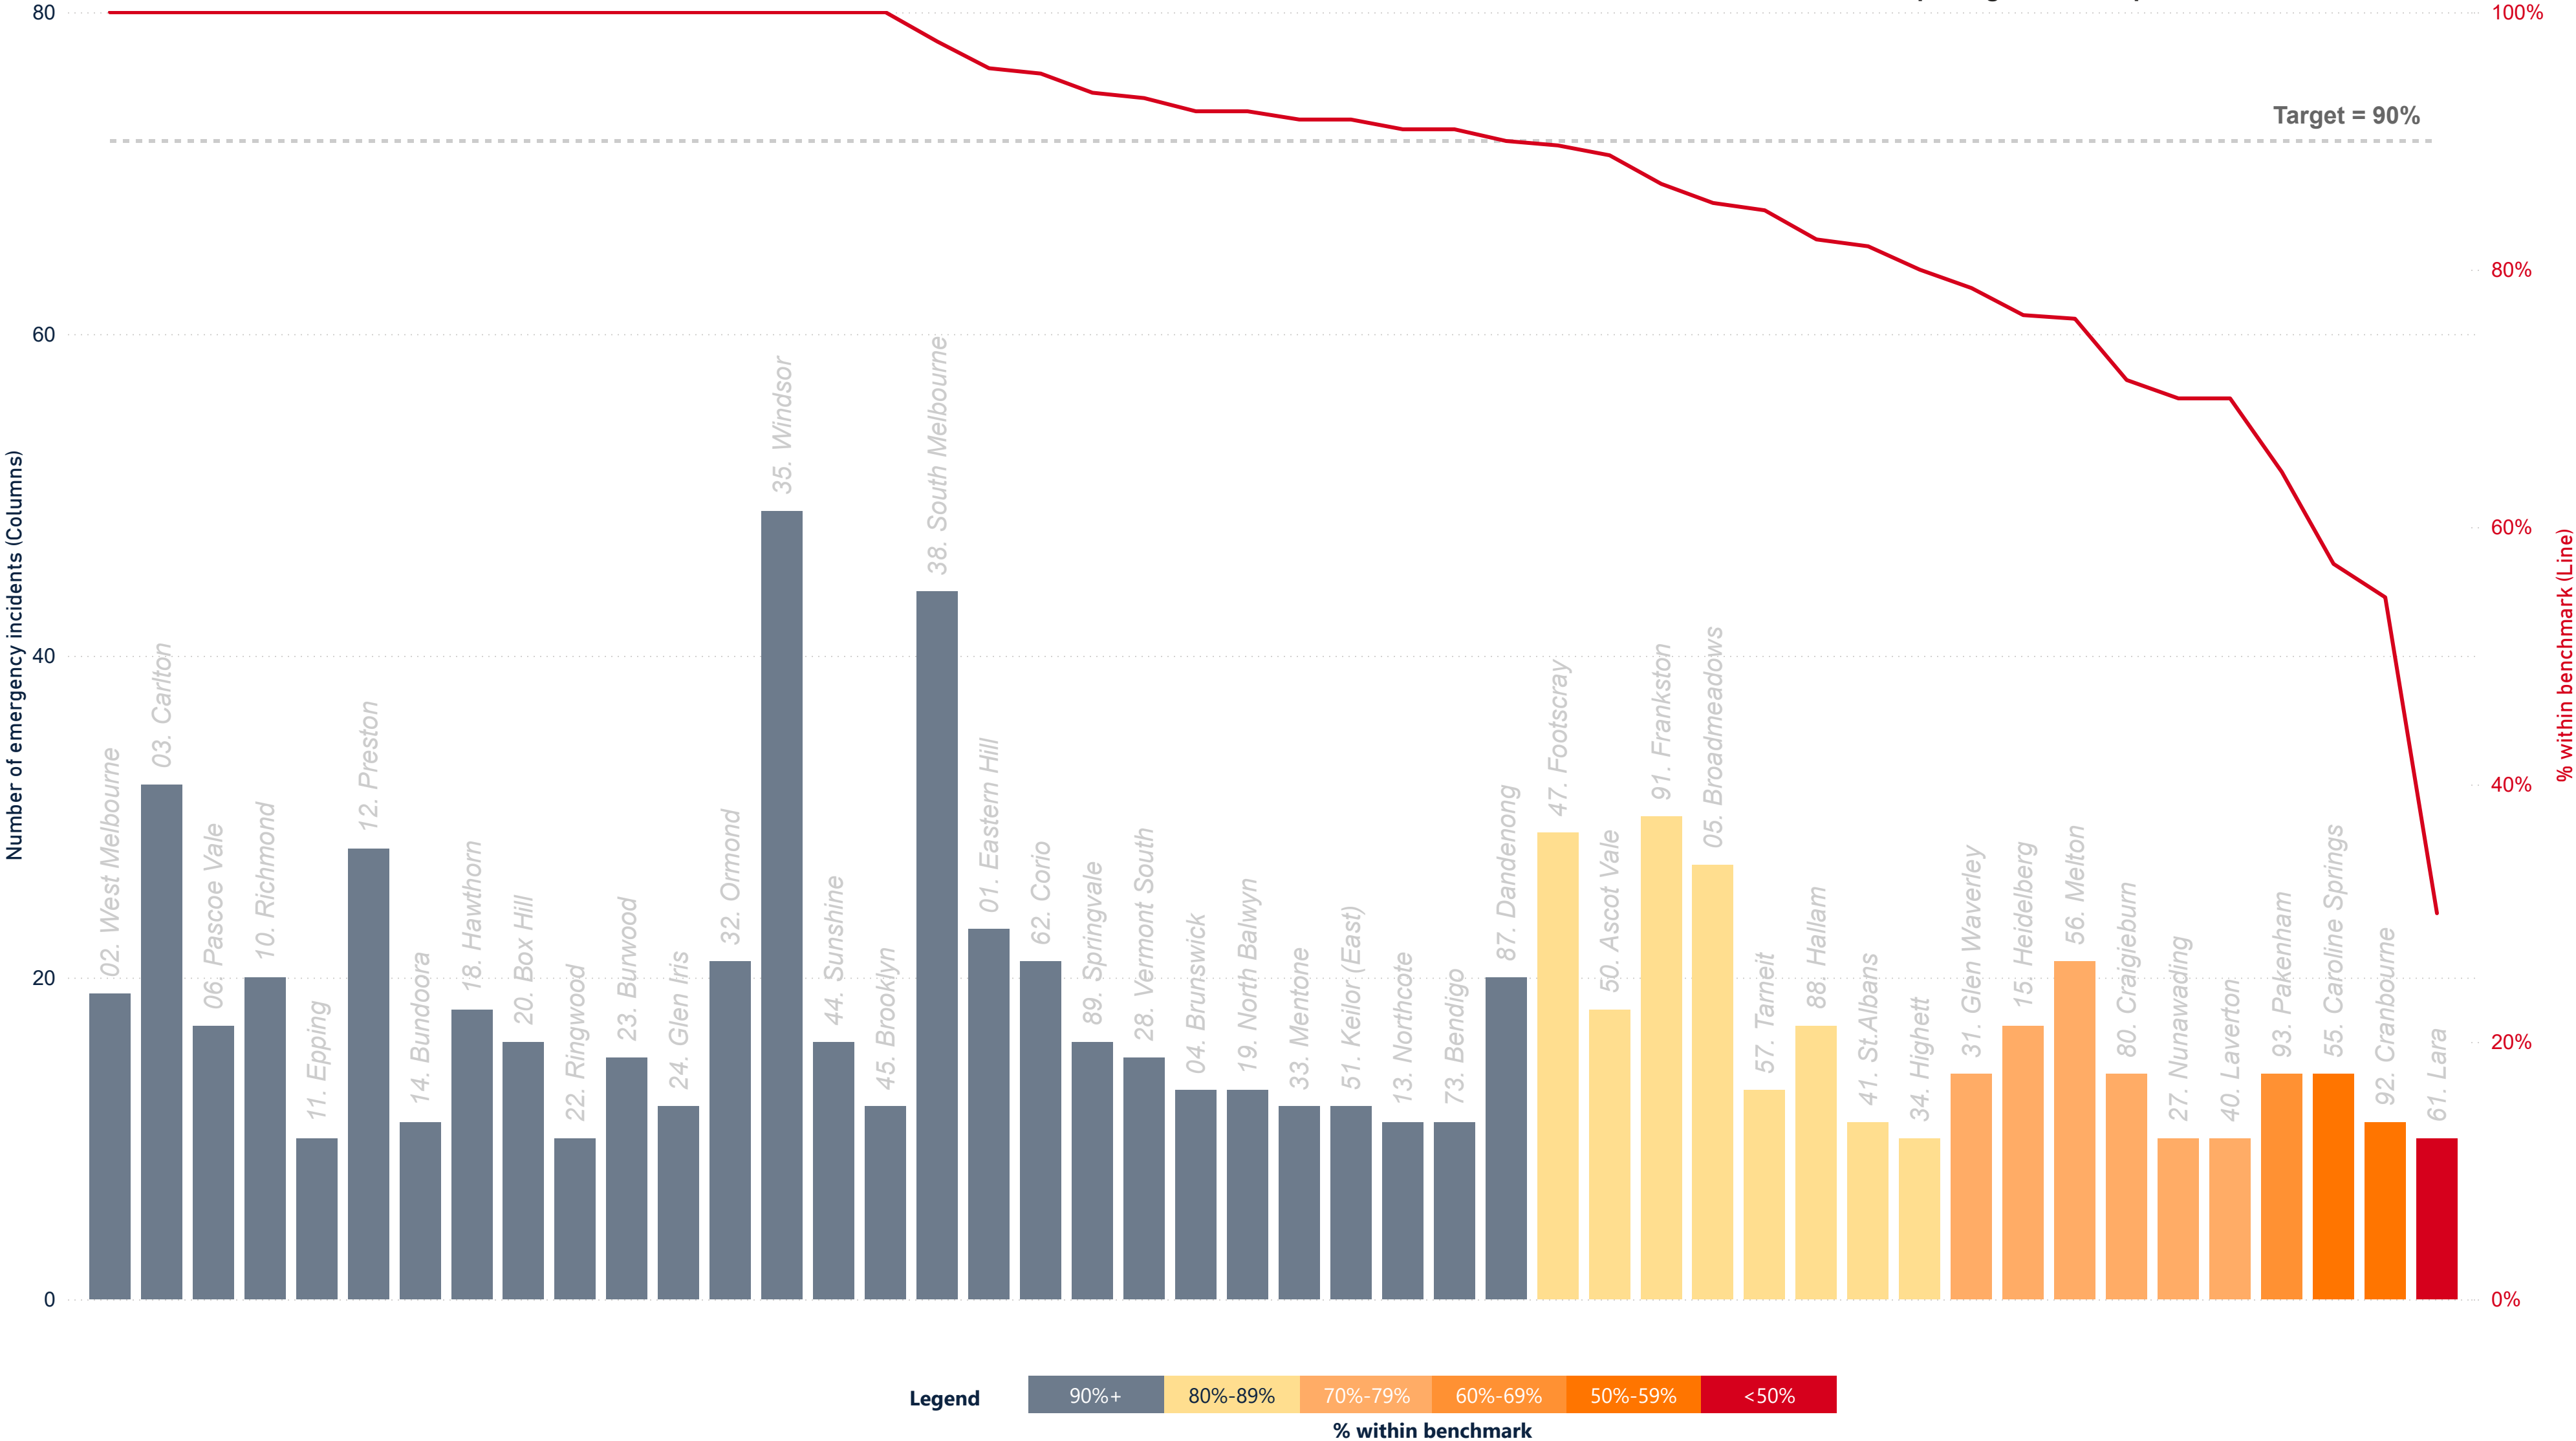

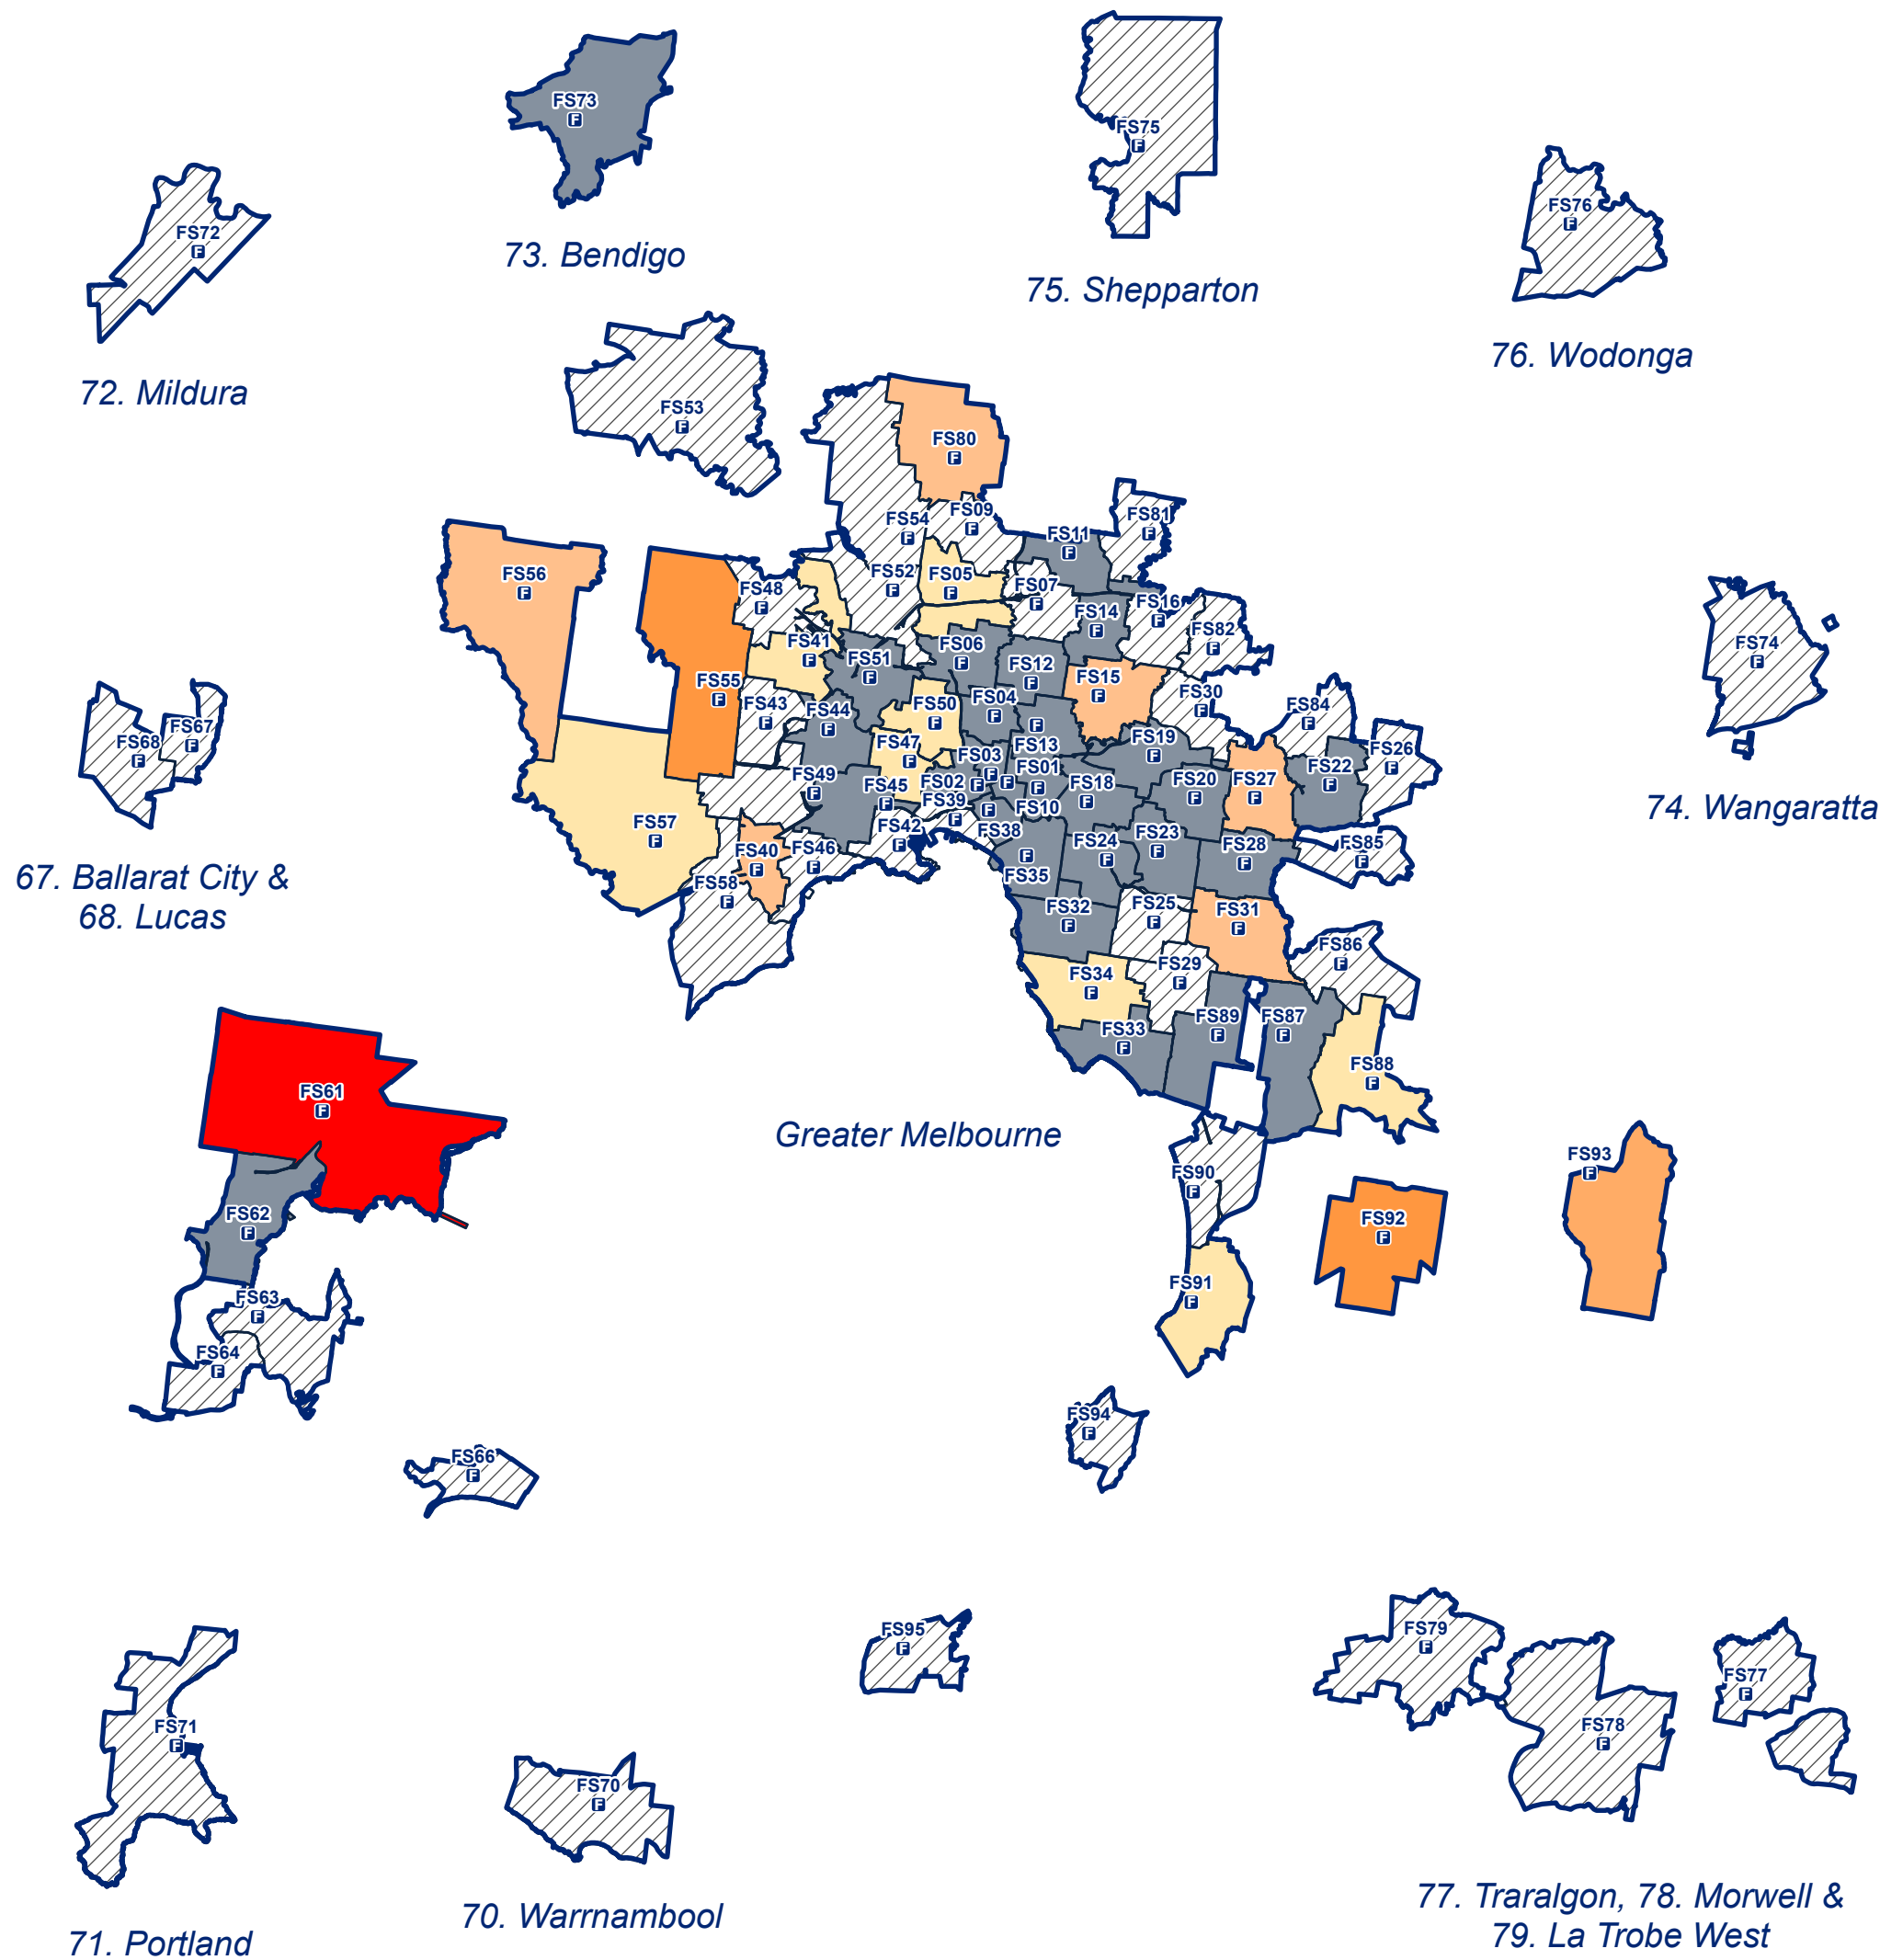



Emergency Structure Fires - Response Times Meeting Benchmarks

Reporting Period: 1 April 2025 - 30 June 2025





Legend

-  FRV Station
-  FRV Boundary
-  Maintenance Area
- Within Target Percentage
 -  <50%
 -  50% - 59%
 -  60% - 69%
 -  70% - 79%
 -  80% - 89%
 -  ≥90%
-  MA with <10 SF incidents

FRV Business Intelligence & GIS
Map produced: September 2025
Request ID: Public Reporting/FY25/Q4/Maps

(c) State Government of Victoria 2025
This map is a snapshot generated from Victorian Government data as well as data from various other sources. This does not guarantee that the publication is without flaw of any kind or is wholly appropriate for your particular purposes and therefore disclaims all liability for error, loss or damage which may arise from reliance upon it. All persons accessing this information should make appropriate enquiries to assess the currency of the data.



Scale
1:500,000

